


HYDRANT TO BE PAINTED @ THE FACTORY
 W/ RUSTOLEUM HIGH-PERFORMANCE EPOXY
 9100 SYSTEM, COLOR #9143 YELLOW.
 HYDRANT TO BE PAINTED BY THE CITY AND
 PAID BY THE CONTRACTOR.

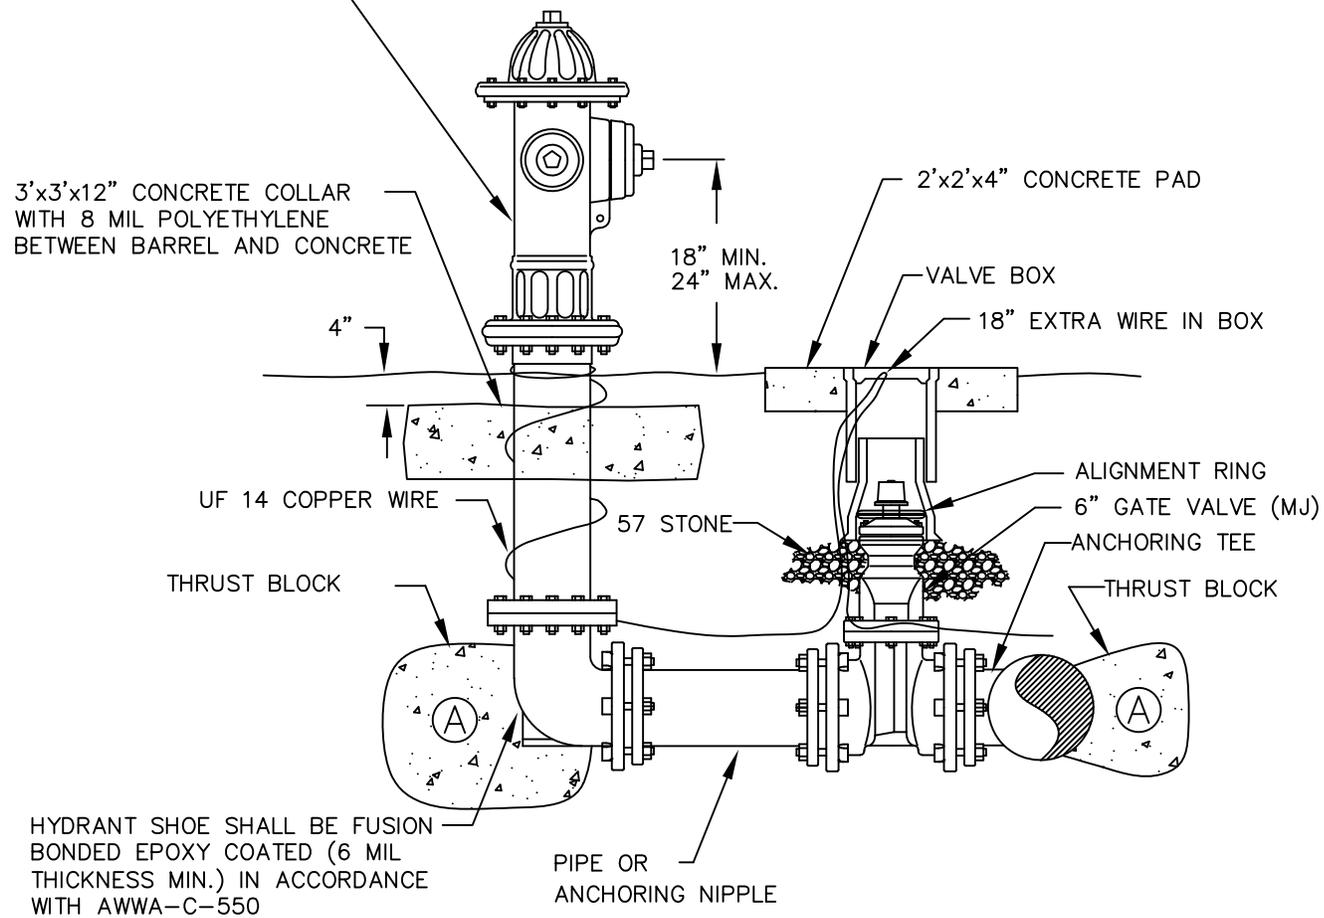

NOTES:

1. CITY CREWS WILL APPLY FINISH PAINT COAT.
2. HYDRANT RISERS WILL NOT BE PERMITTED.
3. FIRE HYDRANT WILL HAVE 18-8 TYPE 304 STAINLESS STEEL BOLTS AND NUTS (BONNET, TRAFFIC FLANGE AND SHOE).
4. SEE "FIRE HYDRANTS" SPECIFICATIONS.
5. PAINT PAID BY THE CONTRACTOR.

(A) REFER TO THRUST BLOCK NOTES AND DETAILS.



CITY OF COCOA
 Brevard County, Florida
 UTILITIES DEPARTMENT
 ENGINEERING DIVISION

FIRE HYDRANT DETAIL

DRAWN BY: J. WILLIAMS	SCALE: NOT TO SCALE
CHECKED BY: P. DAVIS	DATE: MARCH 2020
DESIGN BY:	SHEET: 1 OF 1
ACAD NAME: FIRE HYDRANT DETAIL	