


SWALE CROSSING



NOTES:

1. MAIN SHALL BE A CONTINUOUS LENGTH OF D.I. PIPE TO EXTEND 2 FEET MINIMUM EITHER SIDE OF THE DRAINAGE SWALE.
2. IF 1 OR MORE JOINTS OF PIPE IS REQUIRED, JOINT MUST BE RESTRAINED.

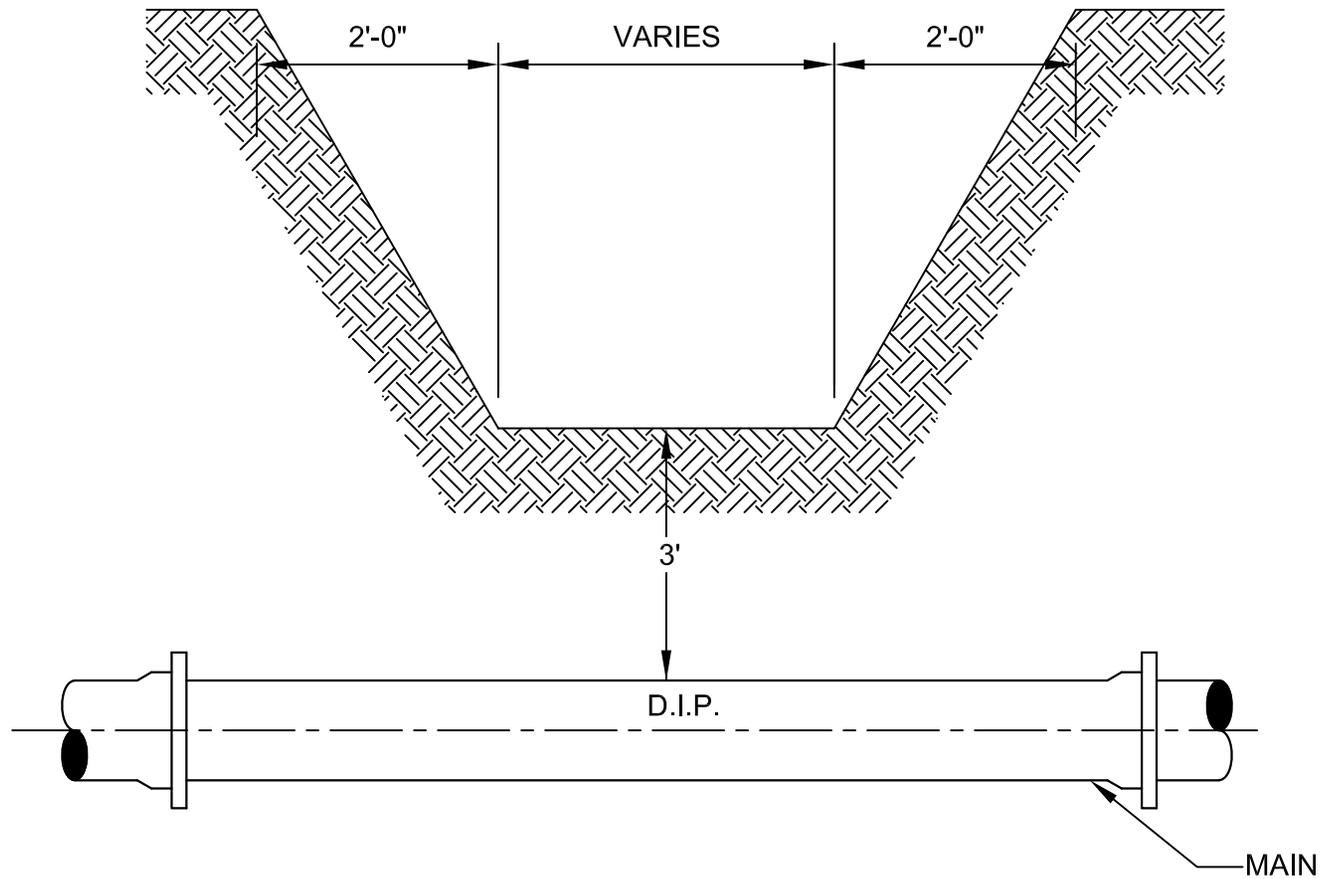

CITY OF COCOA
 Brevard County, Florida
 UTILITIES DEPARTMENT
 ENGINEERING DIVISION

SWALE CROSSING

DRAWN BY: J. WILLIAMS	SCALE: NOT TO SCALE
CHECKED BY: P. DAVIS	DATE: MARCH 2020
DESIGN BY:	SHEET: 1 OF 1
ACAD NAME: SWALE CROSSING	