



1. IF DEPTH IS 30" OR >, PIPE MAY BE PVC PER CITY SPECIFICATIONS
2. IF DEPTH IS 30" TO 24", PIPE TO BE DIP PER CITY SPECIFICATIONS

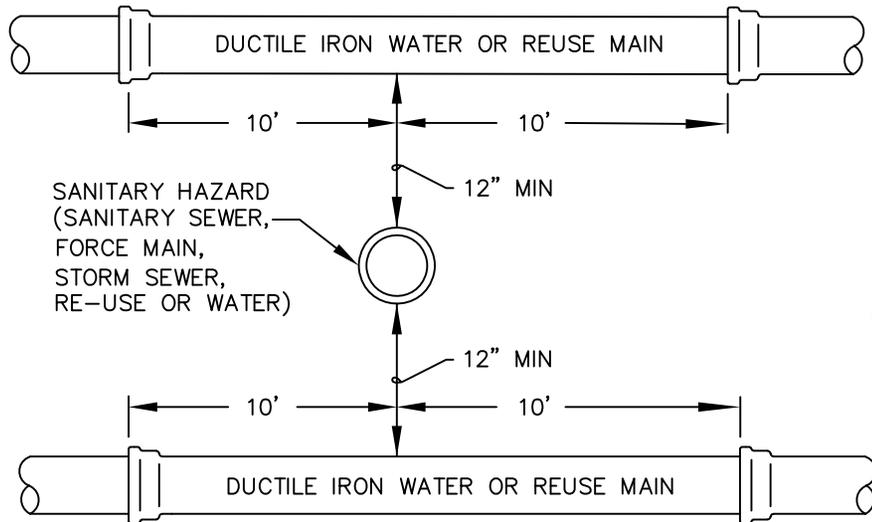

VERTICAL CLEARANCE

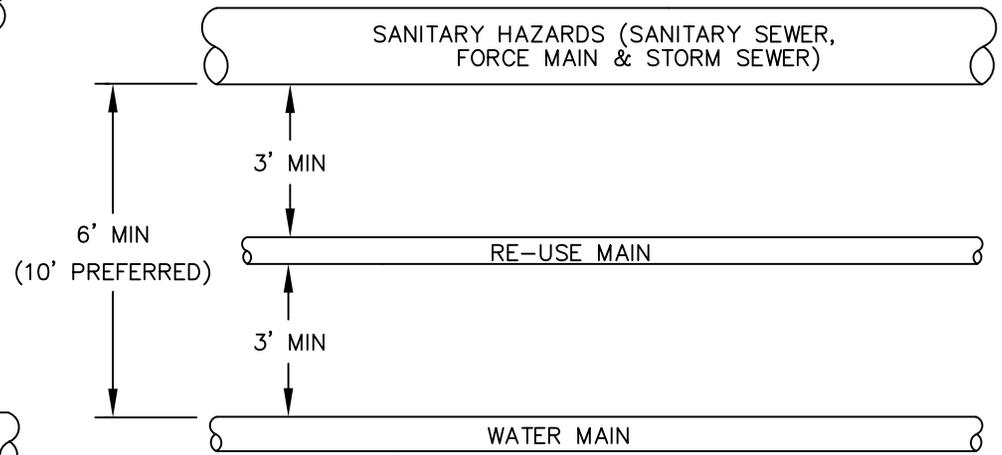

HORIZONTAL CLEARANCE

PER FDEP 62-555.314



CITY OF COCOA
 Brevard County, Florida
 UTILITIES DEPARTMENT
 ENGINEERING DIVISION

TYPICAL REQUIRED SEPARATION

DRAWN BY: J. WILLIAMS	SCALE: NOT TO SCALE
CHECKED BY: P. DAVIS	DATE: MARCH 2020
DESIGN BY:	SHEET: 1 OF 1
ACAD NAME: TYPICAL REQUIRED SEPARATION	