



PLAN

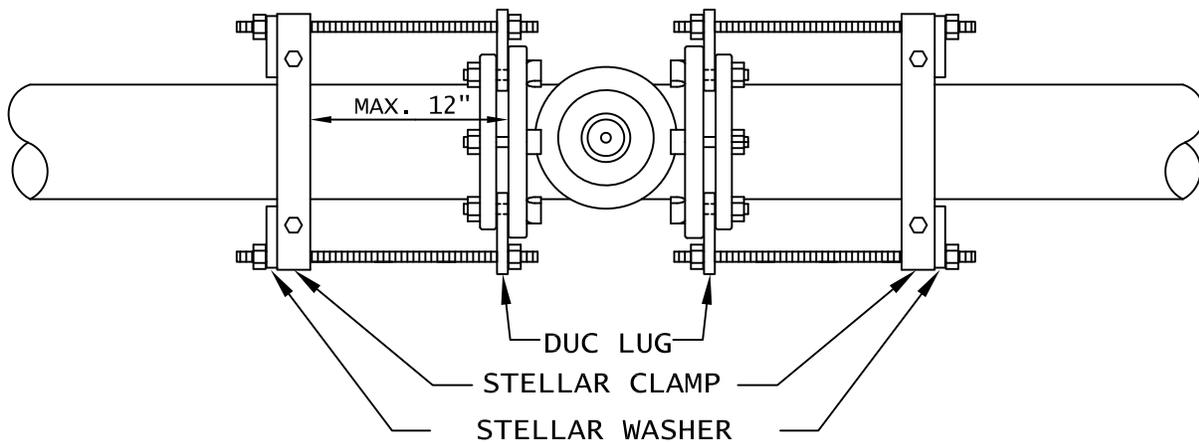

PROFILE

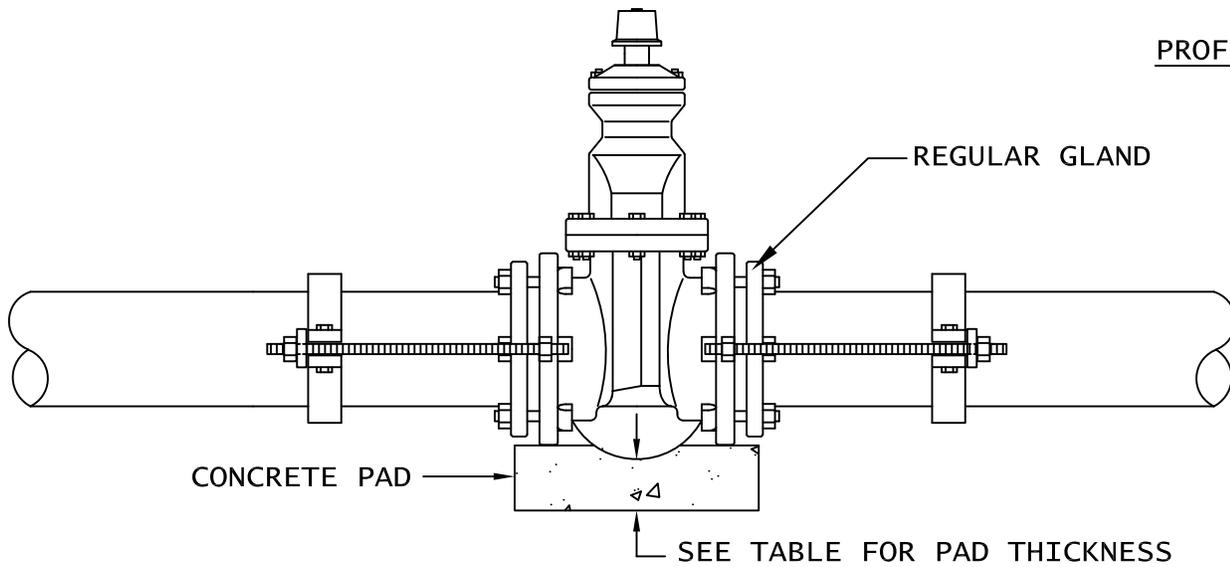

SIZE	MIN. COVER OF PIPE	CONCRETE PAD SIZE FROM LOWEST POINT OF FITTING
4"	24"	16"x16"x6"
6"	26"	18"x18"x6"
8"	30"	20"x20"x6"
*10"	36"	24"x24"x8"
*12"	40"	30"x30"x8"

\* NOTE: 10" AND 12" REQUIRE TWO CLAMPS AND FOUR RODS PER SIDE.

VALVES INSTALLED PER MANUFACTURER'S RECOMMENDATION ON DIP AND PVC.



**CITY OF COCOA**  
Brevard County, Florida  
UTILITIES DEPARTMENT  
ENGINEERING DIVISION

**VALVE INSERT  
FOR A.C. PIPE**

DRAWN BY: J. WILLIAMS

SCALE: NOT TO SCALE

CHECKED BY: P. DAVIS

DATE: MARCH 2020

DESIGN BY:

SHEET: 1 OF 1

ACAD NAME: VALVE INSERT