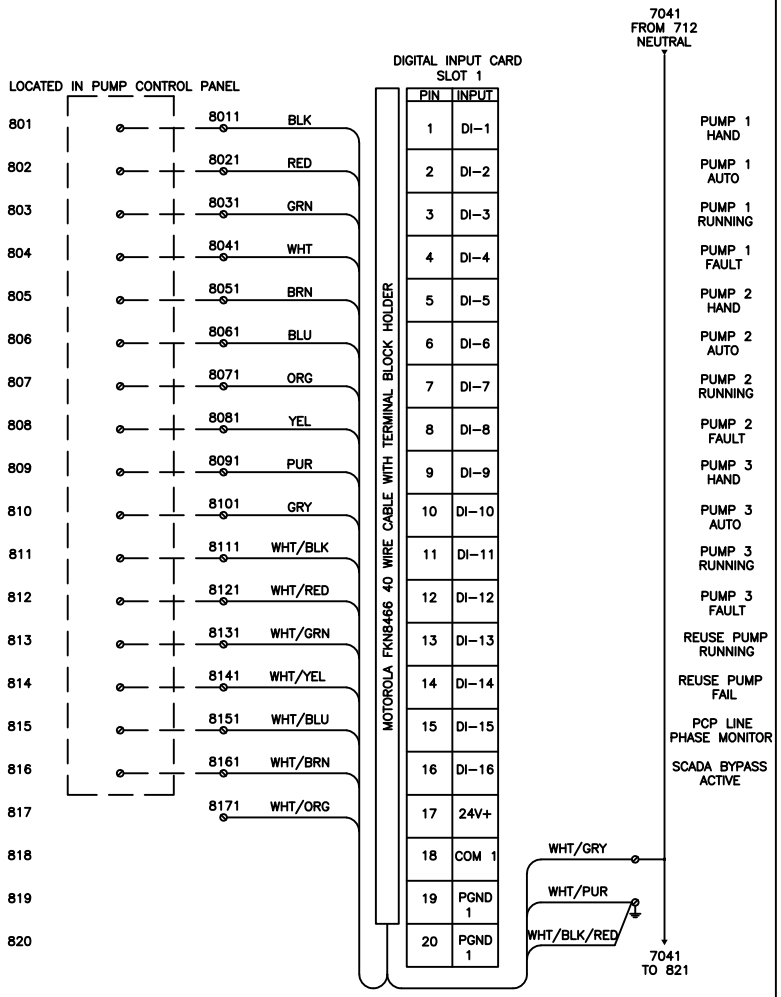

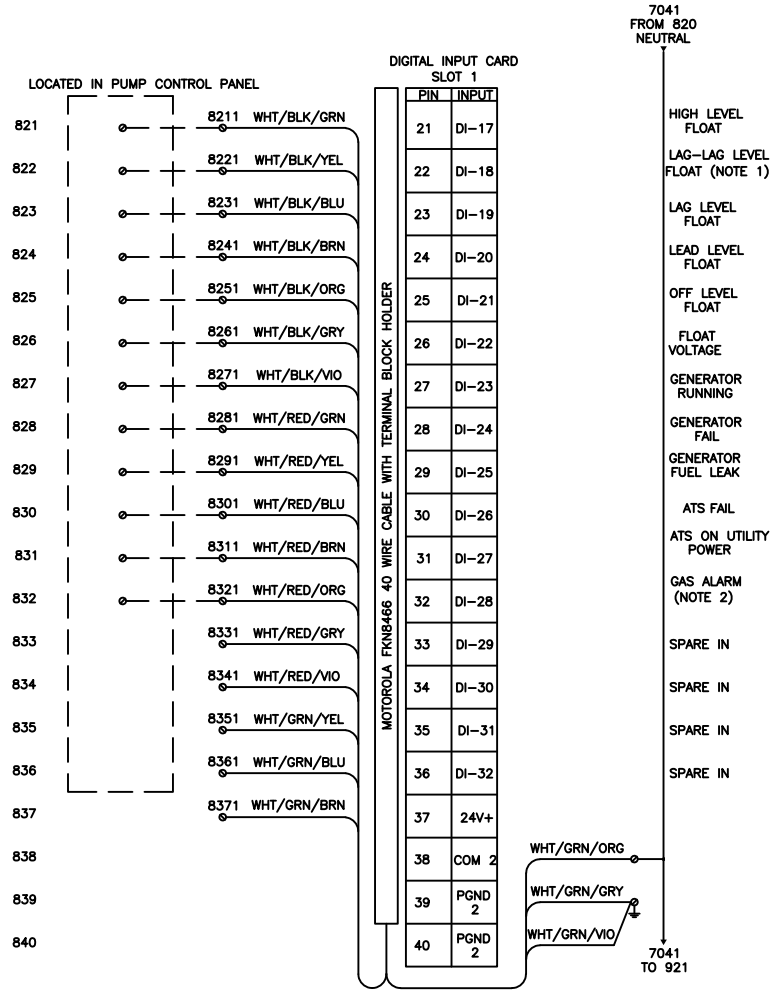

NOTES:
1. ADD JUMPER TO HIGH LEVEL FLOAT IF LAG-LAG FLOAT IS NOT AVAILABLE.
2. INSERT JUMPER TO 7210 IF GAS SENSOR DOESN'T HAVE A DISCRETE OUTPUT CONTACT.

CITY OF COCOA
Brevard County, Florida
UTILITIES DEPARTMENT
ENGINEERING DIVISION

RTU I/O CARD NO. 1
DIGITAL INPUTS: 24VAC

DRAWN BY: CDM SMITH	SCALE: NOT TO SCALE
CHECKED BY: P. DAVIS	DATE: MARCH 2020
DESIGN BY:	SHEET: 1 OF 1
ACAD NAME: RTU I/O CARD NO.1 1-8	